

# Metering, Monitoring and Targeting

A best practice guide for  
businesses in Northern Ireland



## Table of Contents

<b>1.0 Purpose of the Guide</b>	<b>4</b>
1.1 Who is this guide for?	5
1.2 What is the scope of this guide?	5
1.3 How to use this guidance	5
1.4 Additional sources of guidance	5
<b>2.0 What is Metering, Monitoring and Targeting (MM&amp;T)?</b>	<b>6</b>
2.1 What is monitoring and targeting?	7
2.2 Is monitoring and targeting complex?	7
2.3 Is monitoring and targeting easy to implement?	7
2.4 Will MM&T save money?	7
2.5 Does MM&T require trained or specialist staff input?	7
2.6 Is there a significant associated investment cost?	7
<b>3.0 What are the benefits of MM&amp;T?</b>	<b>8</b>
3.1 Energy consumption reduction	9
3.2 How much money will be saved?	9
3.3 Improved product costing	9
3.4 Improved budgeting	9
3.5 Improved planned preventative maintenance	9
3.6 Improved product quality	9
3.7 Waste reduction	9
<b>4.0 What constitutes an MM&amp;T system?</b>	<b>10</b>
4.1 A system for energy measurement, metering and recording	11
4.2 A facility for relating energy consumption and production activity	11
4.3 The derivation of standards – what is current performance?	11
4.4 Comparing performance	11
4.5 A system for analysis – how is performance assessed and variance measured, what does it mean?	11
4.6 A system for reporting – how is the information conveyed and to whom?	11
4.7 A system for improvement- how is the information acted upon?	12
<b>5.0 Planning for the implementation of an MM&amp;T system</b>	<b>13</b>
5.1 Establishing Cost Centres (Energy Accounting Centres)	14
5.2 Who is best able to determine the constitution cost centres?	14
5.3 What basis for energy and production activity should be selected?	14
5.4 Will additional metering be required?	14

5.5	What data collection procedures will be required? . . . . .	15
5.6	Is management commitment essential? . . . . .	15
5.7	Preparing a business plan for MM&T . . . . .	15
<b>6.0</b>	<b>Cost Centres and Specific Energy Consumption (SEC). . . . .</b>	<b>16</b>
6.1	What basis should be used for SEC? . . . . .	17
6.2	What data frequency is required for my cost centres and SEC? . . . . .	18
6.3	What if I produce different products on the same machines? . . . . .	18
<b>7.0</b>	<b>Meter selection . . . . .</b>	<b>19</b>
7.1	What is the Measuring Instruments Directive? . . . . .	20
7.2	Criteria for meter selection . . . . .	20
7.3	Turndown ratio . . . . .	20
7.4	Accuracy . . . . .	20
7.5	Repeatability . . . . .	20
7.6	What does Modbus compatible mean? . . . . .	20
7.7	What meters do I need? . . . . .	20
<b>8.0</b>	<b>Operating the MM&amp;T system . . . . .</b>	<b>21</b>
8.1	Setting standards . . . . .	22
8.2	How is MM&T used to improve control and reduce energy consumption? . . . . .	22
<b>9.0</b>	<b>Calculating Standards . . . . .</b>	<b>24</b>
9.1	Specific energy consumption vs. production . . . . .	27
9.2	Why is volume related SEC important? . . . . .	28
9.3	Regression analysis . . . . .	28
9.4	Alternative solutions for target setting. . . . .	28
<b>10.0</b>	<b>Evaluating Performance change . . . . .</b>	<b>31</b>
10.1	Identifying trends . . . . .	32
10.2	Improving consistency and accuracy . . . . .	32
<b>11.0</b>	<b>CUSUM (Cumulative sum of errors) Techniques . . . . .</b>	<b>34</b>
11.1	CUSUM convention . . . . .	38
11.2	Caution with CUSUM. . . . .	38
<b>12.0</b>	<b>Feedback and reporting . . . . .</b>	<b>39</b>
<b>13.0</b>	<b>How do you assess building energy performance? . . . . .</b>	<b>41</b>
13.1	Degree days . . . . .	42
13.2	Where do I get degree day figures from? . . . . .	42
13.3	Degree Days work in practice? . . . . .	45
13.4	Using the CUSUM analysis to verify trends. . . . .	46
<b>14.0</b>	<b>Energy Performance in Buildings - Key Legislative Changes . . . . .</b>	<b>47</b>
14.1	Energy performance certificates and energy benchmarking . . . . .	48
14.2	Building Logbooks . . . . .	48
14.3	What is in a Building Logbook . . . . .	48
14.4	Energy Savings Opportunity Scheme (ESOS) . . . . .	49
<b>15.0</b>	<b>Other Useful Reading . . . . .</b>	<b>50</b>

# 1.0 Purpose of the Guide

- 1.1 Who is this guide for? ..... 5
- 1.2 What is the scope of this guide? ..... 5
- 1.3 How to use this guidance ..... 5
- 1.4 Additional sources of guidance ..... 5

All businesses consume or produce energy - understanding how much energy we use, for what purpose, and how we exercise control over energy consumption and cost, is vital for environmental and commercial security.

This guide explains, concisely, the basic guiding principles relating to the conception, development and procurement of metering, monitoring and targeting systems (MM&T).

## **1.1**

### **Who is this guide for?**

This guide is primarily intended for companies who currently do not use MM&T, but it is also relevant to those who already operate MM&T systems for building energy consumption or for industrial activities.

## **1.2**

### **What is the scope of this guide?**

This guide covers aspects of concept, development and the practical operation of an MM&T system. The guide does not cover specific installations or products other than by way of example.

It provides a detailed explanation of some of the fundamental aspects of MM&T installation and operation and includes the following:

- The basic concepts
- The system requirements
- The benefits
- Operational considerations

## **1.3**

### **How to use this guidance**

This guide is split into stand-alone sections that may be read in isolation or in sequence. If read in sequence the document follows the procedure that should be adopted to develop a successful MM&T project. However, guidance on specific subject matters may be obtained by reference to the relevant section.

## **1.4**

### **Additional sources of guidance**

This guide contains a list of additional sources of guidance.

# 2.0 What is Metering, Monitoring and Targeting (MM&T)?

2.1	What is monitoring and targeting? . . . . .	7
2.2	Is monitoring and targeting complex? . . . . .	7
2.3	Is monitoring and targeting easy to implement? . . . . .	7
2.4	Will MM&T save money? . . . . .	7
2.5	Does MM&T require trained or specialist staff input? . . . . .	7
2.6	Is there a significant associated investment cost? . . . . .	7

## 2.1

### What is monitoring and targeting?

Monitoring and targeting is a term used to describe a range of management techniques employed to improve understanding of how energy is consumed and business costs are evolved. MM&T is a management system for controlling energy consumption and cost. It allows performance measurement with a greater degree of accuracy and can be used to improve accountability, quality and profitability.

If, specifically, your process systems performance deteriorates, you will be faced with increasing costs and perhaps even product quality or productivity issues.

It is therefore prudent to manage these systems effectively. To manage any system effectively you must have knowledge of its performance.

An excellent analogy is the fuel consumption of a car. A poorly maintained car with worn engine, under-inflated tyres and poor carburettor set up will have poor fuel performance.

Recognising poor fuel performance with fluctuating petrol prices is difficult. But if you keep a simple record of fuel consumed and mileage travelled you may well be able to determine performance. In addition:

- You will be able to identify performance loss quickly.
- You will be able to predict the fuel consumption for a specific journey.
- You may care to drive more sensibly when you are able to see clearly how much fuel you use.
- You may be able to predict the need for service or tune up. (PPM Planned Preventive Maintenance).
- You will be able to see the benefit of tune up.
- You may make allowances or corrections depending on the type of driving you are doing (motorway or urban).
- You could establish whether your Ford Escort compares favourably with the Fords published figures. (Benchmarking).
- You could set your own fuel performance targets to be achieved by careful driving and good car maintenance. (Internal Benchmarking).

The same concepts are true (if not more so) for any fuel or power consuming processes. The process of monitoring and targeting is very similar and can be as elaborate or as simple as required to allow your complete understanding of system performance.

## 2.2

### Is Monitoring and targeting complex?

Monitoring and targeting can be as simple as routinely taking a meter reading and checking consumption against production. Or it can be a complex multivariable process based analytical tool.

Contrary to common belief a useful M&T (monitoring and targeting) system can be extremely simple. It is really not about how complex the system is, it is about how appropriate the system is.

## 2.3

### Is monitoring and targeting easy to implement?

Yes it is a simple management procedure requiring the collection and analysis of energy and production data. In some cases the process can be largely automated using data collection and analysis software.

## 2.4

### Will MM&T save money?

Yes - If you do not meter, then you do not measure and therefore you cannot manage energy effectively.

## 2.5

### Does MM&T require trained or specialist staff input?

Generally not, although some knowledge of process and spreadsheets are useful. MM&T (metering, monitoring and targeting) is really the application of techniques that allow you to carry out existing business and process function with improved control and awareness of energy consumption and cost.

## 2.6

### Is there a significant associated investment cost?

Not necessarily. MM&T can be implemented with relatively little cost (sometimes no capital cost). Where it is necessary to purchase additional metering, there are additional costs.

There are costs associated with managing energy. These costs arise from labour engaged in collecting, analysing and presenting data. However, these costs may be relatively small when compared to the prospective savings potential.

# 3.0 What are the benefits of MM&T ?

3.1	Energy consumption reduction . . . . .	9
3.2	How much money will be saved? . . . . .	9
3.3	Improved product costing . . . . .	9
3.4	Improved budgeting . . . . .	9
3.5	Improved planned preventative maintenance . . . . .	9
3.6	Improved product quality . . . . .	9
3.7	Waste reduction . . . . .	9



### 3.1

#### **Energy consumption reduction**

The obvious benefit is controlling the use of energy. However MM&T can be used for much more and can be used as a performance diagnostic tool for a process or for specific elements of a process. For example, in the context of a boiler, or a steam system this management tool can be adapted and used quite creatively to allow continuous performance analyses.

### 3.2

#### **How much money will be saved**

This is entirely dependent on the process, the site, the existing degree of control and so on. However, for most industrial sites the expectation might be 5% savings potential from MM&T alone.

### 3.3

#### **Improved product costing**

The value of energy as part of the product cost can be assessed and understood using MM&T. If you understand the cost you are more likely to be in a position to control the cost. This is particularly true for variable production runs. It is usually evident that economies of scale exist in most production activities. MM&T can help identify and accurately quantify these economies of scale.

There are two distinct benefits. Firstly, production can be scheduled to achieve the best specific energy consumption and lowest cost per unit production. Secondly, the cost to customer can be passed on accurately and short run product priced with accuracy.

### 3.4

#### **Improved budgeting**

The relationship between production and energy can be established, energy and cost forecasts can be reliably derived for planned production activities.

### 3.5

#### **Improved planned preventative maintenance**

The examination of specific consumption trends can tell a lot about the performance and efficiency. Just as increased fuel consumption in the example of the car can be used to detect the need for a tune up, an MM&T system can be used to detect deteriorating plant performance.

### 3.6

#### **Improved product quality**

Uncontrolled or variable energy performance often results from poor system control with similar adverse implications for quality. A spin off from effective energy management is improved process control and improved production or product quality - It is not a direct effect of MM&T but a secondary benefit.

### 3.7

#### **Waste reduction**

An MM&T system aids the cost of wasted production to be evaluated, understood and hopefully avoided. Waste costs twice in energy terms. The original energy consumed and the energy consumed to make the replacement product.

# 4.0 What constitutes an MM&T system?

4.1	A system for energy measurement, metering and recording.....	11
4.2	A facility for relating energy consumption and production activity .....	11
4.3	The derivation of standards – what is current performance? .....	11
4.4	Comparing performance .....	11
4.5	A system for analysis – how is performance assessed and variance measured, what does it mean? .....	11
4.6	A system for reporting – how is the information conveyed and to whom? .....	11
4.7	A system for improvement - how is the information acted upon?.....	12

#### 4.1

##### **A system for energy measurement, metering and recording**

Metering is an essential prerequisite for effective monitoring and targeting. Energy saving measures may only be identified and implemented if energy performance is understood. To do this metering is required.

The principal barrier to expenditure on metering is the apparent lack of tangible payback. In fact metering provides the evidence to prioritise and justify the installation of energy efficiency improvements.

#### 4.2

##### **A facility for relating energy consumption and production activity**

To understand how production activity is related to energy consumption and cost, it is necessary to measure production output.

The energy consumption per unit production is called the specific energy consumption or SEC. The SEC might well vary with production volume - becoming less with large volume production (economies of scale) and often typically increasing with short production runs.

The basis for quantifying production varies from site to site and production activity to production activity. Many companies produce a range of products from similar feed stocks and there may be some considerable variation in specific energy consumption. It may be necessary to develop a series of product specific indicators or develop an SEC that uses raw materials as a measurement basis.

MM&T is routinely used to record and examine the performance of buildings and in that specific circumstance the SEC might vary with external air temperature, occupancy and other variables.

In some cases it may be necessary to develop relatively complex relationships if the consumption patterns are to be understood. However, wherever practical, the least complex and simplest relationships usually work best.

#### 4.3

##### **The derivation of standards – what is current performance?**

To evaluate any improvement in control, and variation in SEC or cost, the current performance has to be understood. Since the SEC may vary with production volume, temperature or some other variable, the current performance and the performance relationship must be understood.

The derivation of target data and the analysis of that data is explained in this guide.

It is self evident that unless there is a mass of historical data, then the ongoing comparison of performance cannot be made until sufficient “current performance data” is assembled. There are two possible solutions:

- Sufficient historical data is available and can be analysed to set a target.

or

- The system must be operated and used initially just to collect data to allow analysis and the derivation of a target.

#### 4.4

##### **Comparing performance**

Comparison is usually straight forward and visual comparison of data is often sufficient to allow comprehension of the energy trend and cost and ultimately allow action for control.

In some more complex arrangements where an MM&T system is used to monitor specific plant or process, it is useful to develop a statistical protocol for analysis that allows rapid trend analysis, alarm setting and provide easily understood data analysis.

In most cases a simple relationship between production and consumption can be established and used for the purposes of comparison. This guide explains several basic techniques, and provides some worked examples.

#### 4.5

##### **A system for analysis – how is performance assessed and variance measured, what does it mean?**

The use of CUSUM techniques (Cumulative Sum of Errors from target) is a simple but particularly useful way of comparing performance when there is a scale related variation in SEC. The CUSUM technique allows quick, accurate trend information to be determined and can be accomplished very simply using basic spreadsheet tools.

The CUSUM technique may be used to rapidly analyse large and complex data sets - and vital trends.

A more detailed explanation is given in this guide.

#### 4.6

##### **A system for reporting – how is the information conveyed and to whom?**

Analysing performance is meaningless unless the information is acted upon. Even if the sole purpose of the data collection is to check invoices or some equally simple arrangement, the information is worthless unless it is collated, presented and action is taken.

A formal reporting system is therefore required. This might take the form of a straightforward performance or feedback report that is delivered to individuals that have control over the process, heating or other controlled system.

#### 4.7

##### **A system for improvement – how is the information acted upon?**

There is little point in having a control system without feedback and error correction - the analogy of the car is ideal once again. If the fuel consumption is consistently poor then the driver may have to service the vehicle, adjust driving style or make improvements to the process e.g. remove items stored unnecessarily in the boot, check tyre pressures, etc.

# 5.0 Planning for the implementation of an MM&T system

5.1	Establishing Cost Centres (Energy Accounting Centres) . . . . .	14
5.2	Who is best able to determine the constitution cost centres? . . . . .	14
5.3	What basis for energy and production activity should be selected? . . . . .	14
5.4	Will additional metering be required? . . . . .	14
5.5	What data collection procedures will be required? . . . . .	14
5.6	Is management commitment essential? . . . . .	15
5.7	Preparing a business plan for MM&T. . . . .	15

## 5.1 Establishing Cost Centres (Energy Accounting Centres)

MM&T will be used primarily to ascertain the energy consumption associated with a production activity or building. It is important to establish cost centres. A cost centre is an area of business activity, process or plant that can be metered effectively and where there is opportunity to manage and reduce energy consumption.

Cost centres might be determined geographically - a good example would be a district heating system where individual buildings are metered. The energy flow to each building would be monitored (with or without line losses) and the boiler operation might equally constitute a cost centre. In this way the individual building performance, line losses and the boiler house efficiency might all be monitored and consequently managed.

Likewise where separate processes are conducted in different buildings, e.g. rubber mixing and tyre moulding, and it is relatively easy to separately meter and monitor these processes individually. Cost centres might be determined on existing adopted accountancy bases e.g. the weld shop or the paint shop.

It is more difficult when the process stages are contiguous or there are multiple processes in one building (as often is the case). However if a methodical approach is adopted and in house process knowledge is used, an acceptable compromise will almost always be determined.

The important issue is to create a system that provides useful measurement of operational aspects over which you might be able to exercise cost effective control.

These might be:

- process activities (packing and finishing)
- geographical areas (South side production area)
- specific systems (the steam distribution system or boiler house)
- plant items (the boilers or indeed a specific boiler)

Creating a useful MM&T system will require some careful survey and initial analysis of the energy consumption, consumption patterns and production activities.

## 5.2 Who is best able to determine the constitution cost centres?

In developing an MM&T system you could solicit advice from a consultant experienced in the development of MM&T systems. However, it is unlikely that an external consultant or MM&T supplier will have the detailed business knowledge required to establish an optimal solution. An external consultant will, however, be able to explain and define relevant analysis methods.

Cost centres are best developed internally - where practical these should be independently metered so that the energy performance can be ring fenced. Often, however it is not possible to arrange for discrete separation and some compromise is required.

## 5.3 What basis for energy and production activity should be selected?

In selecting cost centres it is also important to consider the Specific Energy Consumption indicators Key Performance Indicators (KPI's) that will be derived - because it is useful to determine clear and easily used, trended Specific Energy Consumption indicators.

Remember that the SEC is a measure of energy per unit product (or similar). In some cases compromise over exact geographical or process stage delineation will allow a far superior SEC to be more easily collected.

Choosing SEC and the basis for deriving SEC is addressed in the following guide section.

## 5.4 Will additional metering be required?

Yes, because most sites in the UK will only have the utility company's service meter. The accuracy of the meter should be good and there is a legal duty of care for metering to be accurate and within +/-2% (gas) and +2.5% to 3.5% (electricity). Some 93% of meters are generally within these limits. However if you are spending £50,000 on electricity each year the error could be worth as much as £1,750.

Having identified cost centres it will be necessary to meter these in order to provide a basis for an energy/production relationship.

Notwithstanding the Government's 'Smart' metering programme (which will affect domestic and small commercial users) larger sites will be equipped with 'Smart' or advanced utility metering by 2019 allowing full data download. However, the installation of client owned sub metering is a vital part of understanding the breakdown of energy use.

For each cost centre the requirement for metering should be assessed. Metering is addressed in a following section of this guide.

## 5.5

### **What data collection procedures will be required?**

Clearly the meters must be read. Meter reading gives rise to the most difficulty in data analysis. Automatic data collection is far superior to manual collection because the "time of reading" errors can largely be eliminated.

Manual meter reading is acceptable but may be time consuming, depending on the number of meters. Sometimes manual data collection can be irregular or introduce meter reading errors.

Of course the energy or water consumed is only one half of the equation. Accurate energy metering is pointless if the production related activity cannot be measured. Likewise then a means of measuring production must be determined.

Data must be collected regularly, at the same time each day, week or whatever the metering period selected so as to provide comparative intervals of energy and production data.

## 5.6

### **Is management commitment essential?**

Yes, senior management backing and support are required. This is important because the performance of cost centres or buildings will be examined and there must be a commitment to act on the information distilled from the MM&T process.

It is important to understand that MM&T is a management diagnostic system and it requires management input to affect an outcome - MM&T is not a passive system and the managerial structure and staff accountability are a key component of the system architecture.

Senior management commitment is required to support and underwrite the project. Local or cost centre management is required to review and determine the cause of performance variation and provide rectification or control.

## 5.7

### **Preparing a business plan for MM&T**

There is a cost associated with providing and operating an MM&T system and therefore to implement an MM&T system, a structured development and implementation plan is usually required.

- The potential costs and savings have to be identified.
- The concept must be sold to senior management.
- The methodology and timescale for implementation must be determined.
- The functional and operational requirements of a system must have been established.
- The staffing and skill requirements assessed.

The costs arise, amongst other things, from:

- The level to which monitoring and targeting is exercised (keep it simple)
- Additional meter requirements
- Data collection (time if the system is not automated)
- Analysis requirements (this can also be automated)
- The actual implementation and day to day operation

A balance is required to ensure that the cost of operating the MM&T system does not exceed the potential benefit. Clearly it would be nonsensical to measure monitor and target every aspect of one business or production activity.

# 6.0 Cost Centres and Specific Energy Consumption (SEC)

6.1	What basis should be used for SEC ? .....	17
6.2	What data frequency is required for my cost centres and SEC?.....	18
6.3	What if I produce different products on the same machines?.....	18



**6.1 What basis should be used for SEC?**

MM&T is generally used to trend performance, so repeatability is more relevant than accuracy (this is explained further within metering section).

The cost centres should be first determined – this is a fundamental consideration of any MM&T system. Refer to the preceding guide section.

Explaining the nature of cost centres and the selection of SEC is important and best explained by the following example:

In the glass container industry, raw material is mixed and fed to melting/holding furnaces. The molten glass is conditioned and sent to moulding machines. The bottles are then annealed and quality inspected before packing.

Mixing sand to melt for glass is an electrically intensive process stage. This is an ideal cost centre as the energy consumed in this process activity is easily measured. The installation of sub-metering allows the kWh/tonne batch to be determined. The large mill motors will have very large fixed losses. It is therefore essential that the mills are loaded optimally and the monitoring process ensures this is the case.

The derivation of a simple kWh electrical power per tonne mixed, allows the volume related performance and the ongoing performance of the plant to be monitored “the mpg of the batch mixing plant”

The batch mix is melted and the melt energy is dependent on a range of factors. In most furnaces it is dependent on the ambient conditions (which affect the temperature of the charge and the combustion air) and the preheat delivered by heat recovery. The melt energy per tonne is a critical factor for energy efficiency and commercial success.

The melt energy/tonne can be correlated with ambient air temperature and that relationship used to establish a target kWh/tonne melted. Large or consistent variations from this target will be indicative of reducing heat recovery performance, poor mixture control, electrode failure (requiring more gas) and so on. The derivation of an automated trending system will quickly alert the operators to system underperformance which in the case of large furnaces could cost many tens of thousands of pounds per year.


The furnaces might therefore usefully be considered as a separate cost centre and the primary kWh/tonne pulled (pulled from the furnace - the batch weight) considered as the KPI (key performance indicator) with seasonal correction.

The glass must be thermally conditioned prior to moulding as this process is extremely sensitive because temperature stratification will result in a partly formed or deformed bottle at moulding. Monitoring the gas consumed/tonne flow through the conditioning furnaces (forehearths) is also an important KPI. If defective product is produced then it will not be detected until it has been through the annealing ovens consuming electric energy and is either rejected because of breakage after the annealing oven, or as a result of inspection rejection at the quality inspection stage.

The forehearths or conditioning furnaces each have their own gas and power supplies and are thus easily metered separately - the performance of the forehearths is of interest because it is indicative of initial melt condition, forehearth control and an indicator of quality issues to come.

After moulding glass containers are reheated and distressed in annealing ovens. Mouldings of defective quality tend to become over stressed and fail during this annealing process. The performance of the annealing ovens, expressed in terms of kWh/tonne processed is valuable - but the quantity that progresses to be packed, is also critical because it is indicative of the initial mould quality and annealing effectiveness, so kWh/tonne pulled and kWh tonne packed are critical KPI.

The quality inspection process which counts bottles and weight is of low power consumption. However, the metered production data quantifies the losses between tonnes pulled and packed and the cost of waste to the business. The variation in loss is indicative of the process performance and the individual KPI trends flag up specific process variations.

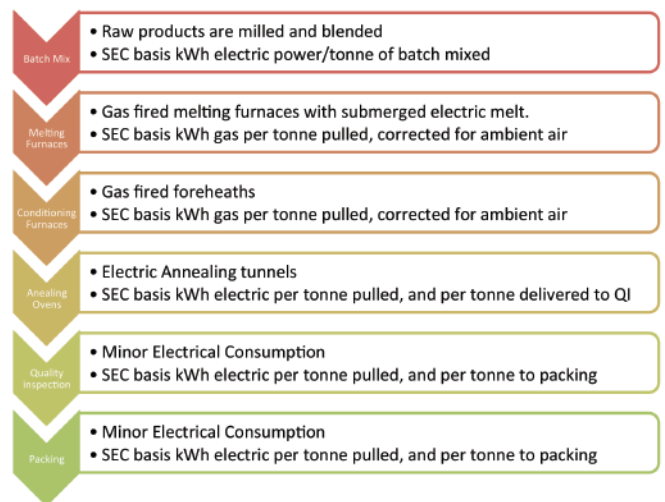

With some relatively simple metering and process quantification, significant insight into the energy and correct process performance can be established.

In practice, the operation of specific plant might be monitored in more detail (again for example), the air flows to the forehearths might be monitored and the correlation between quality or gas consumed would be established.

The preceding example illustrates how cost centres and SEC may be established. These indicators allow analysis of the different processes, process stages and may be used to gauge process control as well as simply keeping track of energy and cost.

By splitting the processes down into logical cost centres (EAC) with appropriate KPI the opportunity for improved management then arises.

Again by way of an example, if the ratio of tonnes glass bottles packed to tonnes melted starts to fall whilst the forehearth gas/tonne produced rises it might logically be assumed that the bottle rejection or break rate has increased, and because the overall gas/tonne has increased this might be an initial molten glass quality or conditioning issue. A decrease in gas consumption might prompt the same investigation. Regardless, the variation and any trend are used to prompt investigation and resolution before any major technical or commercial damage is done.

Specific Energy Consumption Indicators are usually Key Performance Indicators of kWh/unit raw material or kWh/unit finished component or kWh/degree day for a buildings energy consumption. In some circumstances however it might be necessary to relate kWh to hours of production time or some other less tangible measure of production activity. For most industries however there are usually some good credible KPI's.

## 6.2

### **What data frequency is required for my cost centres and SEC?**

The frequency of data measurement depends entirely on the likely variation in consumption of the processes and what is to be achieved with the data.

If the data is being used to trend overall kWh/kg or kWh/unit of production over a long time frame to determine any drift in performance, then a longer time frame between measurements is appropriate - a daily consumption or weekly consumption might suit.

If, however, the data is being used to say examine compressor performance and the suitability of sequence control, then data collection might have to be every minute - just for example.

## 6.3

### **What if I produce different products on the same machines?**

If for example you were logging a textile conditioning process and you switched from a grade 1 cotton to grade 12 cotton then it would be appropriate to MM&T these processes separately.

The same would be true for any other industry whether it be castings, injection moulding, glass containers and so on.

Break it down logically so that you are not comparing oranges with apples.

# 7.0 Meter selection

7.1	What is the Measuring Instruments Directive? . . . . .	20
7.2	Criteria for meter selection. . . . .	20
7.3	Turndown ratio . . . . .	20
7.4	Accuracy . . . . .	20
7.5	Repeatability . . . . .	20
7.6	What does Modbus compatible mean? . . . . .	20
7.7	What meters do I need? . . . . .	20

## 7.1

### What is the Measuring Instruments Directive?

The MID (Measuring Instruments Directive - 2004/22/CE) is a 2004 European Directive applicable to measuring devices and systems in the context of commercial transactions (e.g. the sale of heat, power fuel etc). However the MID is having a profound effect on the quality of metering available in the market and non MID metering will become rarer.

The benefit of MID compliant metering is that the metering is built, classified and certified to BSEN standards and therefore can be relied on to produce reliable metered data. You do not legally require to install MID compliant metering unless you are using the metering to charge a third party.

The MID sets out standards of accuracy, durability (repeatability) and turndown requirements for MID metering.

## 7.2

### Criteria for meter selection

The choice of metering equipment will be determined by site conditions and by the metering objectives. These in turn will determine the relative importance of criteria such as:

- Turndown ratio
- Accuracy
- Repeatability

## 7.3

### Turndown ratio

Is the ability of the metering to function sufficiently accurately over a range of flow without loss of accuracy or potential repeatability.

This is an important factor in meter selection if the process variable to be measured (e.g. gas, oil, water or electricity) varies significantly during production.

## 7.4

### Accuracy

Might be considered as the ability to report a measured value that was close to the actual value or within an acceptable % of the real flow. Accuracy would be determined by testing and the meter subsequently calibrated.

Most modern electricity meters are extremely accurate e.g. +/-0.5%.

Most modern heat meters are extremely accurate e.g. +/-2.0%.

## 7.5

### Repeatability

Reflects the variation in measurement made by the same meter for the same flow and all other conditions being the same. Repeatability is relatively important for MM&T particularly where there are small changes in process efficiency

Curiously perhaps, accuracy is less important for MM&T than turndown or indeed repeatability.

Accuracy, for instance, may be less important than repeatability for an MM&T system, but the reverse may be true where the performance of an item of equipment such as a boiler needs to be assessed. An accurate meter costs more than a meter which is simply capable of good "repeatability". A careful choice must be made to make best use of capital available?

## 7.6

### What does Modbus compatible mean?

Metering will generally provide a measure of cumulative flow e.g. the digits on a gas meter, electricity meter or oil meter - but most meters will provide a pulsed output. Many meters will also be addressable and use a serial bus to transfer data. This is similar to the way that data is transferred inside a computer. A common bus (wires) is used to transfer discrete packages of encoded data. The encoding contains the address of the meter and the encoded raw measurement data. A central computer based monitoring system can poll up to 47 individual devices and receive measured data in return. The data can then be decoded and presented as raw data in text, csv (comma separated value) or other formats depending on the data processing provided in your computer.

## 7.7

### What meters do I need?

Accuracy is not critical for MM&T unless the MM&T system is used for specialist process control. Thus a lower accuracy is acceptable. A MID compliant meter is preferable. When you purchase a meter it is beneficial to have:

- A physical indication of instantaneous flow or power
- A cumulative record of flow or power
- A pulsed output
- Modbus compatible

# 8.0 Operating the MM&T system

8.1	Setting standards.....	22
8.2	How is MM&T used to improve control and reduce energy consumption?.....	22

**8.1  
Setting standards**

Initially the principal energy consuming systems must be identified and metered. Improved energy efficiency, productivity and cost reduction may then be affected through better operation, work scheduling or process improvement. Initially however the “standard” or “as is” performance must be evaluated.

Installed metering may be used to provide the “standard” consumption (or alternatively historical data might be used if it is available). Initially this target is simply the existing performance.

The “standard” performance will very often exhibit some energy to production correlation and these relationships are considered in due course.

With a standard performance measured and understood, agreed improvements can then be implemented. These might range from increased productivity, better tuning, optimised control - anything and everything that will potentially reduce consumption and improve quality.

The performance improvements will be identified by analysis of the ongoing energy and production data.

The revised and improved operational or maintenance procedures will maintain this improvement.

Over time a new standard performance can be identified and the procedure reiterated. The standard figures must be adjusted to account for any factors that might have influenced consumption - e.g. extreme weather, increased or reduced production and so on.

However the basic concept is:

- Measure
- Assess performance
- Set the standard
- Monitor performance
- Improve performance
- Measure the improvement
- Revise the standard

MM&T should be a practical, simple and effective way of ensuring that continuous control and improvement are achieved or that high performance standards are being maintained.

In reality it is nothing more than common sense, but it is essential to only collect and produce information that is useful.

**8.2  
How is MM&T used to improve control and reduce energy consumption?**

The objective of MM&T is to understand and control some process related variable. That would usually be energy but it could equally be water consumed or waste produced or all three.

MM&T could equally be used as a quality driver and quality control indication.

It is marginally more complex than understanding the MPG of a car but the concept is similar. In this way, the MM&T system is being used to detect changes in energy performance and check on an ongoing basis that performance is being maintained. The analysis should not be complex and should allow change of performance to be detected.

In all cases the objective is to:

A	First identify and quantify energy and cost performance
B	Improve control by technology change, process optimisation or maintenance/ housekeeping action
C	Reduce and maintain that improvement in energy efficiency



# 9.0 Calculating Standards

9.1 Specific energy consumption vs. production . . . . .	27
9.2 Why is volume related SEC important? . . . . .	28
9.3 Regression analysis. . . . .	28
9.4 Alternative solutions for target setting. . . . .	28



The process can be best explained using an example, in this case a textile facility.

The data might be collected and presented as illustrated in Table 1 below.


**Table 1**

1	2	3	4	5	6	7	8
	Actual Steam (kg)	Gas consumed (kWh)	Cost (£)	Production (m)	Cost £/1,000m	Target Steam (kg)	Target Cost
Jan	230,827	205,508	£7,193	303,324	£23.71	242,273	£7,841
Feb	237,965	236,076	£8,263	292,705	£28.23	236,411	£7,651
Mar	243,856	225,793	£7,903	349,221	£22.63	267,608	£8,661
Apr	175,005	153,837	£5,384	172,780	£31.16	170,213	£5,509
May	191,335	168,192	£5,887	263,875	£22.31	220,497	£7,136
Jun	230,148	202,310	£7,081	239,004	£29.63	206,768	£6,692
Jul	125,594	111,818	£3,914	123,365	£31.72	142,935	£4,626
Aug	262,373	249,594	£8,736	309,962	£28.18	245,937	£7,960
Sep	249,003	243,548	£8,524	252,177	£33.80	214,040	£6,927
Oct	278,766	265,188	£9,282	317,583	£29.23	250,144	£8,096
Nov	291,288	269,711	£9,440	382,054	£24.71	285,732	£9,248
Dec	212,103	191,291	£6,695	309,366	£21.64	245,608	£7,949
Total	2,728,263	2,522,866	£88,300	3,315,416			
Averaged Gas consumed/kg steam			0.9247kWh				
Averaged cost per kg steam			£0.032				

In laying out the monthly steam consumption, the monthly gas consumption, the cost and the production activity, it becomes possible to set some target values. The use of a spreadsheet e.g. MS Excel or similar is useful and the table form allows easy manipulation of the data. The amount of data required to produce standards depends very much on the process – has production activity changed recently? Will it change again soon? Have new boilers been installed? etc. Starting off with the wrong data will make life difficult initially.

The standard is simply for any given parameter the existing energy/production relationship. In this specific example, some analysis is required and the relationship of steam consumption to production is plotted to determine a relationship.


The plot of steam v production is illustrated below:

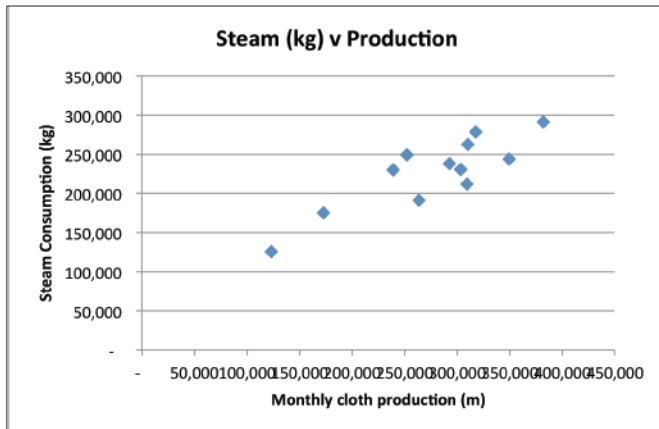

In practice the more historical data you can get, the better. Usually a monthly measurement frequency is adequate.

The standard is usually calculated by some correlation of consumption to production. This is true for any consumption/production relationship. In considering the relationship plotted above it might be observed that as the production activity goes up - so perhaps unsurprisingly does the steam consumption. The relationship is actually linear although there appear to be quite large variations.


The linear relationship in this data plot can be analysed using MS Excel data analysis either with the “data add in” which may be used to determine the relationship by regression analysis or simply using the MS Excel graphing function to provide a best fit as below:

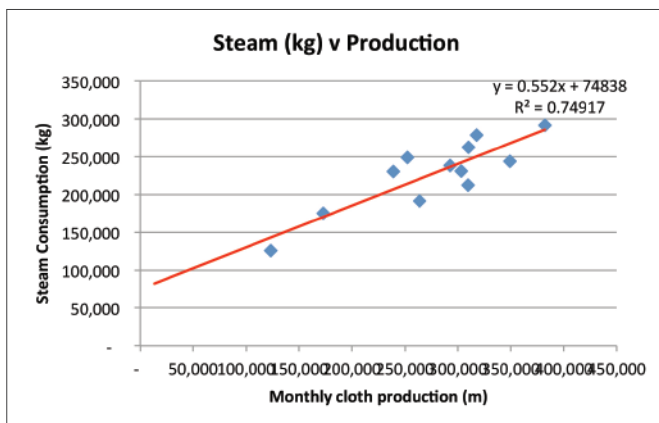

If the MS Excel functionality is used to add a best fit line then this line represents the standard performance. Although there is variation in performance the best fit line may be used to predict what the steam consumption for any production run will be. So for example if the production in any month was increased to say 390,000m cloth the expectation would be that the steam consumed would be  $(390,000 \times 0.552) + 74838$  or 290,000kg costing £9,390.

Columns 7 and 8 of table 1 on page 25 can be completed accordingly.

This is similar to saying my car does 30mpg and I am going to undertake a journey of 500 miles so I will consume 16.6 gallons of fuel. However whereas the car mpg may be fairly consistent, the production activity here has a degree of fixed energy consumption - that is to say energy that will be consumed regardless of the production volume - production related but production volume independent consumption. This is illustrated below:

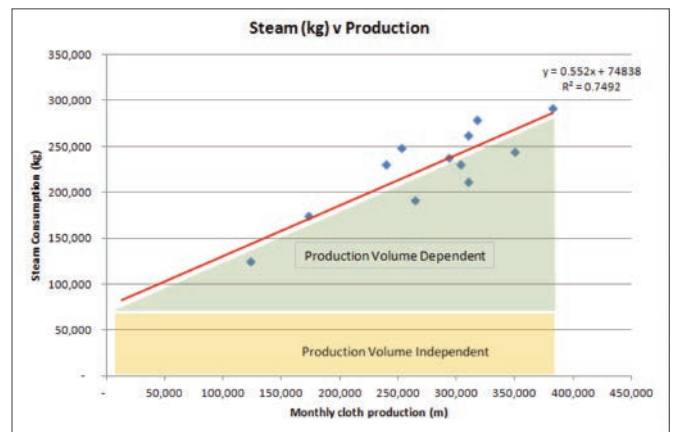

In cases like the one illustrated above a regression analysis is required to determine the correlation between production and steam consumption.

The relationship may of course be very different and the next example considers the boiler efficiency achieved which is unlikely to be linear. However, considering further the production versus steam consumption relationship it appears that if the plant is started and made ready for production, there is an energy consumption regardless of production volume. This might well be fixed heat losses or boiler losses - similarly if the car is started but not driven, the idle fuel consumption will result in consumption regardless of how far one travels.

Although the boiler performance might vary, this established relationship is likely to be satisfactory for ensuring that performance is maintained. Additionally this relationship may be used for the purposes of cost estimating and determining any improvements in efficiency. This technique is suitable for many simple consumption versus production relationships where the energy consumed varies as some function of production.

**9.1 Specific energy consumption vs. production**

In this example the fixed losses are fairly significant and that means that at low production volumes the energy consumed per m of cloth will increase - (something similar to saying that if we do a lot of urban driving the mpg will reduce) - analysing the performance in terms of specific energy performance is valuable for it allows an understanding of the marginal costs of production.


1	2	3	4	5	6	7	8	9	10
	Actual Steam (kg)	Gas consumed (kWh)	Cost (£)	Production (m)	Cost £/1,000m	Target Steam (kg)	Target Cost	Actual SEC	Target SEC
								2/5	7/5
Jan	230,827	205,508	£7,193	303,324	£23.71	242,273	£7,841	0.76	0.80
Feb	237,965	236,076	£8,263	292,705	£28.23	236,411	£7,651	0.81	0.81
Mar	243,856	225,793	£7,903	349,221	£22.63	267,608	£8,661	0.70	0.77
Apr	175,005	153,837	£5,384	172,780	£31.16	170,213	£5,509	1.01	0.99
May	191,335	168,192	£5,887	263,875	£22.31	220,497	£7,136	0.73	0.84
Jun	230,148	202,310	£7,081	239,004	£29.63	206,768	£6,692	0.96	0.87
Jul	125,594	111,818	£3,914	123,365	£31.72	142,935	£4,626	1.02	1.16
Aug	262,373	249,594	£8,736	309,962	£28.18	245,937	£7,960	0.85	0.79
Sep	249,003	243,548	£8,524	252,177	£33.80	214,040	£6,927	0.99	0.85
Oct	278,766	265,188	£9,282	317,583	£29.23	250,144	£8,096	0.88	0.79
Nov	291,288	269,711	£9,440	382,054	£24.71	285,732	£9,248	0.76	0.75
Dec	212,103	191,291	£6,695	309,366	£21.64	245,608	£7,949	0.69	0.79
				390,000		290,118	£9,390		
Total	2,728,263	2,522,866	£88,300	3,705,416					
Averaged Gas consumed/kg steam			0.9247kWh						
Averaged cost per kg steam			£0.032						

If the specific energy consumption indicator is calculated for each of the standard data entries - then a SEC can be calculated.

This target data can then be plotted against production to see how production volume affects the specific energy consumption and of course the cost.

The performance of this particular example is illustrated below and the chart illustrates that if monthly production drops below 250,000m the unit energy consumption and cost will start to rise very rapidly. This is the marginal cost of under-utilising the plant.

Although the methodology used is relevant to energy and cost, it is equally relevant to labour cost and other raw materials or resources.

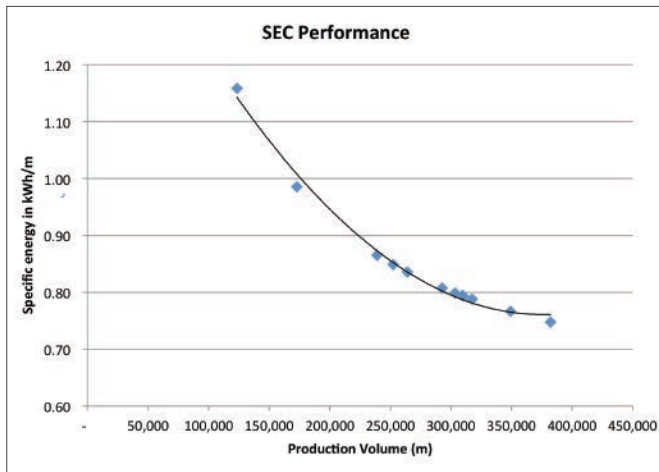

**9.2**

**Why is volume related SEC important?**

MM&T is rarely used to analyse production related SEC variations - but as can be seen the information is important for it allows an understanding of economies of scale, and should allow production managers to optimise production scheduling. It is a vital tool in processes with high fixed overheads and particularly where there is potential to vary production scheduling.

**9.3**

**Regression analysis**

Regression is a useful technique for considering raw performance data. It can be used to analyse specific energy performance and it allows a sliding target based on production (or some other variable parameter).

**9.4**

**Alternative solutions for target setting**


If the boiler fuel to steam efficiency were considered, it might be logically concluded that there would be a variation in efficiency associated with high and low fires. This is almost always the case. If production is very variable and unpredictable - the fuel to steam efficiency (or fuel to hot water heating efficiency) might have to be evaluated using a regression based analysis of the performance. This technique allows a performance range to be evaluated.

However, where production variation results predominantly from the changes in production runs or hours run and does not significantly reduce boiler demand, then a slightly different technique could be used to determine the standard and subsequently analyse the performance.

If the data for a boiler operation is considered:-

	Gas Consumed (kWh)	Steam Produced (kg)	Energy is steam (kWh)	Fuel to steam ratio
Week 1	54,700	67,037	43,760	80.0
Week 2	45,401	52,163	34,051	75.0
Week 3	48,683	55,934	36,512	75.0
Week 4	53,606	63,232	41,277	77.0
Week 5	47,042	57,651	37,634	80.0
Week 6	53,059	61,774	40,325	76.0
Week 7	44,307	50,227	32,787	74.0
Week 8	48,683	58,171	37,973	78.0
Week 9	45,401	50,772	33,143	73.0
Week 10	43,760	54,300	35,446	81.0
Week 11	53,606	65,696	42,885	80.0
Week 12	47,589	54,677	35,692	75.0
Week 13	47,589	54,677	35,692	75.0
Week 14	53,059	63,400	41,386	78.0
Week 15	53,606	62,411	40,741	76.0
Week 16	44,307	49,548	32,344	73.0
Week 17	49,777	61,003	39,822	80.0
Week 18	45,401	50,772	33,143	73.0
Week 19	43,760	54,970	35,883	82.0
Week 20	53,606	64,875	42,349	79.0
Week 21	49,230	55,808	36,430	74.0
Week 22	50,324	57,048	37,240	74.0
Week 23	49,230	56,562	36,923	75.0
Week 24	50,324	58,590	38,246	76.0
Week 25	48,683	59,663	38,946	80.0
Week 26	54,700	61,171	39,931	73.0
Week 27	51,965	61,297	40,013	77.0
Week 28	53,606	59,947	39,132	73.0
Week 29	49,230	60,333	39,384	80.0
Week 30	54,153	67,196	43,864	81.0
Week 31	43,760	50,948	33,258	76.0
Week 32	51,418	59,864	39,078	76.0
Week 33	44,307	51,585	33,673	76.0
Week 34	54,153	68,025	44,405	82.0
Week 35	50,324	57,048	37,240	74.0
Week 36	51,418	59,864	39,078	76.0
Week 37	44,854	54,283	35,435	79.0
Week 38	51,418	61,439	40,106	78.0
Week 39	49,230	61,087	39,876	81.0
Week 40	45,401	52,163	34,051	75.0
Week 41	45,401	57,031	37,229	82.0
Week 42	50,324	61,674	40,259	80.0
Week 43	47,042	53,328	34,811	74.0
Week 44	44,307	49,548	32,344	73.0
Week 45	45,948	54,199	35,380	77.0
Week 46	53,606	64,053	41,813	78.0
Week 47	54,700	64,523	42,119	77.0
Week 48	49,777	57,191	37,333	75.0
Week 49	50,871	63,123	41,206	81.0
Week 50	50,871	59,227	38,662	76.0
Week 51	54,700	65,361	42,666	78.0

It could be established by statistical analysis that the mean value of fuel to steam ratio was 77 and that the standard deviation was 2.77. In practice 68% of all achieved performance should fall within one standard deviation ( $\sigma$ ) and 95% within two standard deviations. A simple xbar and range chart might be assembled as illustrated below:

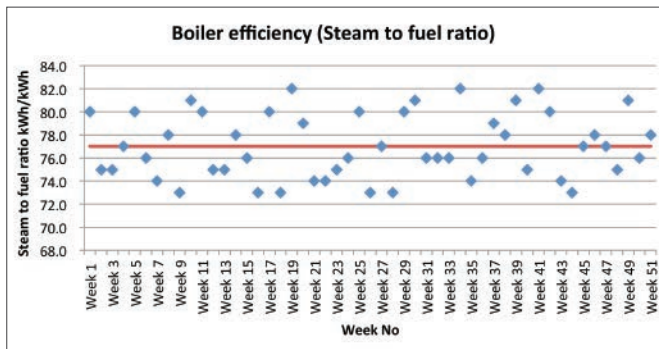


The performance of the boiler expressed as fuel consumed/kg of steam raised varies significantly and there may be any number of reasons for this. A detailed statistical analysis would actually reveal a very small (for the example data) standard deviation and actually relatively good boiler control. However this illustrates another methodology suitable for setting a target value for plant where the SEC is less likely to vary significantly because there is no significant change in operational parameters.

However just as in the previous example what target value should be set? - In this case, it might be assumed to be the mean value or a fuel to steam ratio of 0.77. That ratio could be used initially for predicting performance.

This is another methodology for target setting. At this juncture it is worth noting that the results will (by and large) fall into a band width around the mean value. The mean value will have been derived from “dirty” historical data.

If it were assumed that a normal distribution applied, then approximately 80% of values should fall into a value of  $1.2\sigma = x - u$  or essentially an upper limit of the mean + 1.2 x the standard deviation and a lower limit of the mean less 1.2 x the standard deviation ( $\sigma$  is the internationally accepted symbol for standard deviation). Some knowledge of the plant being monitored and its normal operational performance is required and this is simply a suggestion. So despite the historical band width, some initial limits on operational performance could be applied so as to provide immediate review for future performance:

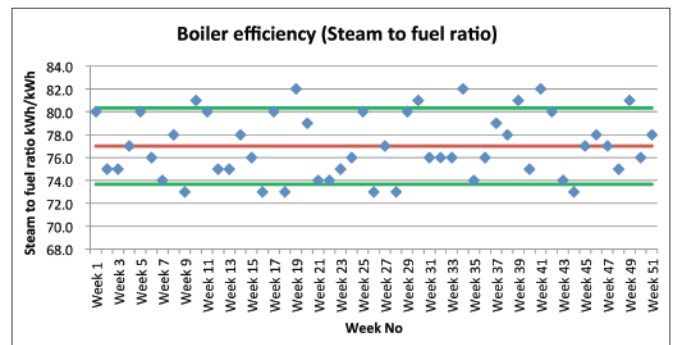

In practice the fuel to steam ratio varied outside these limits but a performance picture and target with agreeable limits has been set.

Note that in the context of a simple MM&T system it would not be necessary to conduct any complicated statistical analysis - and indeed upper and lower limits for the purposes of targeting could be set by assuming the mean + say 80% or some preferred arbitrary % of the range.

# 10.0 Evaluating performance change

10.1	Identifying trends .....	32
10.2	Improving consistency and accuracy .....	32




Identifying and tracking performance change is perhaps the most challenging aspect of MM&T. The presentation of data will help but it is often difficult to identify consistent change. There are two important aspects:

**10.1 Identifying trends**

Having set and charted standards (refer to section 9 for examples) the performance is monitored on an ongoing basis and new data recorded in accordance with the metering and monitoring programme adopted.

Having made changes to your production activity to improve efficiency it is important to identify these. There are two elements of interest, namely trends and actual tangible improvements in performance: Having set standards and limits, trends might be identified as consistent departures from the standard e.g. continually achieving better or worse performance. However there will undoubtedly be oddball results or one off events - and that can make identification less straightforward.

Using the example in the preceding figure, the performance exhibits a wide variation but no trend could be identified. However by setting limits and considering ongoing performance a trend may be identified as illustrated below:

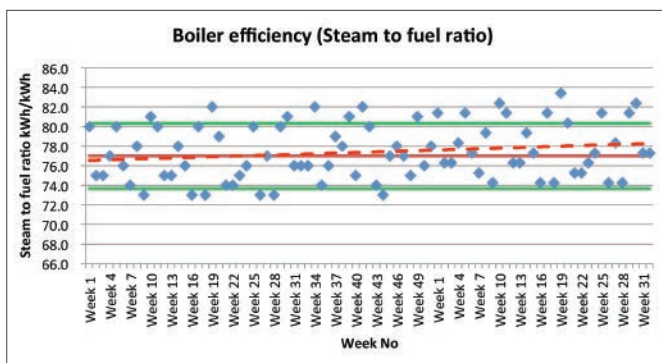

Adding several more weeks' performance data and leaving the standard control limits on the chart allows the variation in performance to be visualised. In this example the kg steam raised per kWh gas burned, has increased slightly and the steam to fuel ratio therefore increased slightly. The results are consistently higher and the performance of the boiler has improved slightly.


In analysing the data - you must start with the standard and initially consider the performance in relation to that standard. Again in the example case considered, the frequency of performance results exceeding the upper control limit was higher and the frequency of performance results exceeding the lower limit negligible.

By analysing and setting process-specific targets, the consistent over or under performance may be used to judge trends and used as an alarm for over or under performance.

**10.2 Improving consistency and accuracy**

If control is improved then it might be expected that the variation in performance result might reduce (not necessarily with overall efficiency variation).


Considering the same example again:

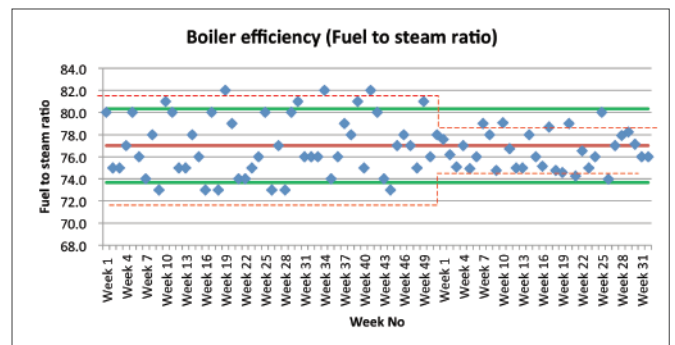

Although in this example, the overall efficiency may not have increased the mean performance remains 77, the repeatability has improved - i.e. the results are being achieved more consistently.

This is beneficial, but of course a performance improvement is also desired and improved control will usually result in a consumption reduction. Whilst this example has simply considered a ratio of fuel to steam, the same analysis could be made for many energy/production parameters.

As the MM&T system is developed, and the performance analysis is fed back to the production staff, managers etc. - the expectation would be for improved control and reduced consumption as illustrated in the following chart.

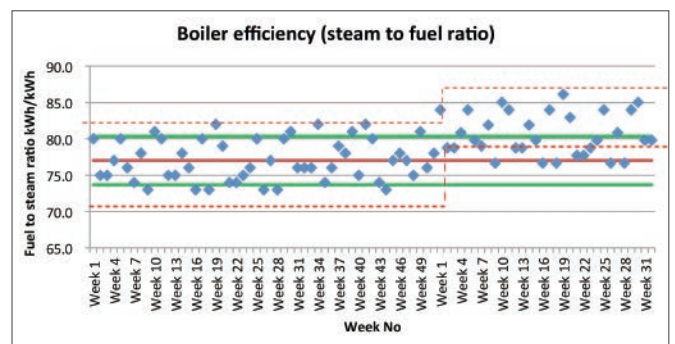


In the chart above the control has been improved (the range is reduced) but the performance expressed as the ratio of fuel to steam has increased suggesting the boiler is working more efficiently.




In practice it is sometimes difficult to detect these changes and a CUSUM (cumulative sum of errors) technique may be used to identify and track improvements. (CUSUM is addressed in the next guide section).

The same methodology might be applied to a more complex regression based relationship (one defined by using regression techniques discussed in section 9 of this guide).

If the chart below is considered - two separate years of monthly gas v production data for the same process have been plotted. The data in blue represents the first year, and the blue line the target fit, for that set. The green data is represented by the following year's data and the green line, the target best fit for that data. There is apparently very little difference, but the spread of the green data is substantially reduced - a fact that is statistically meaningful and reflected in the correlation co-efficient of the data which is much higher. On first examination, the control has been improved, albeit with little efficiency improvement.

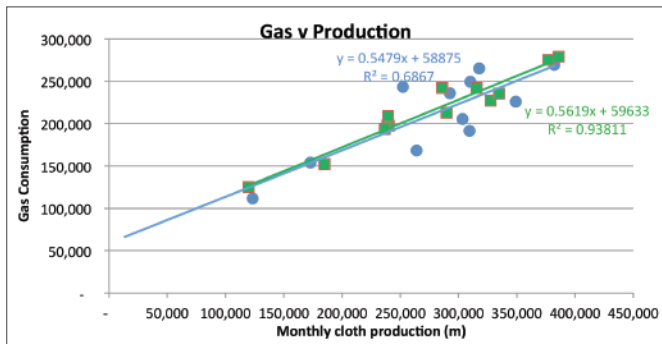


Here are the same two years compared where the production efficiency has been optimised and the gas consumed per unit has dropped by approximately 10%. A comparison made after efficiency improvements were implemented, allows a visual comparison with the standard performance and the confirmation that an improvement has been made.

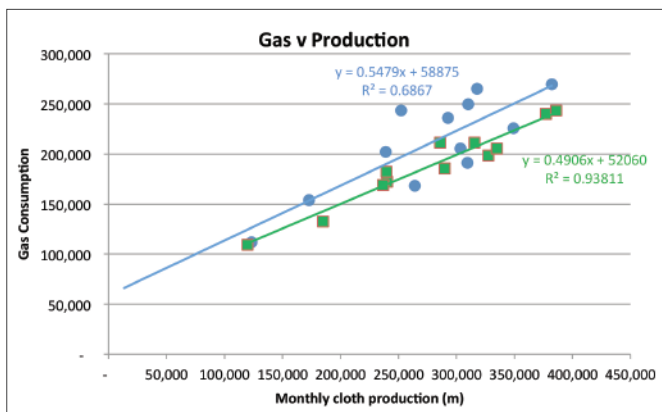

The revised standard and revised target data (green) can be evaluated - using the same technique described in section 9 of the guide.

Comparing basic raw data is useful because the contrast in performance can readily be seen. To observe a trend, the SEC must be evaluated using the technique previously described.

If a third year of data is added then a similar comparison of the data can be added and compared. In this example something has gone wrong in year three for the gas consumption v production is slightly higher than year 1.

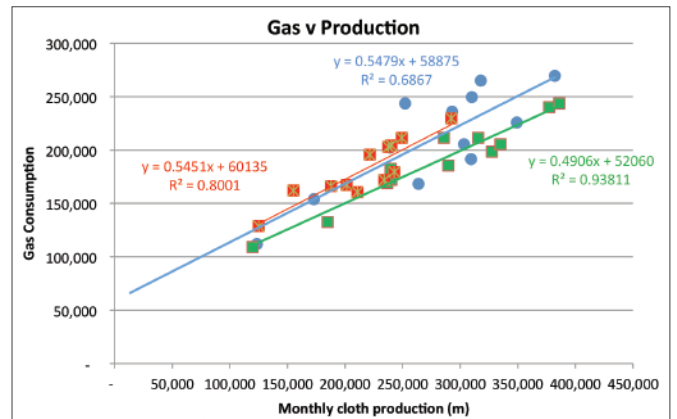

This approach to data analysis and presentation is useful but it is relatively difficult to discern when things changed or the time of change - often the time of performance change can be linked to production events or changes and the versatile CUSUM technique can be used to further analyse performance.

# 11.0 CUSUM Techniques (Cumulative sum of errors)

11.1	CUSUM convention .....	38
11.2	Caution with CUSUM.....	38


Interpreting changes in data can be awkward, particularly where there is a large data set and or there are unlogged production changes. The CUSUM analysis is helpful in understanding when performance changed and whether it is being maintained.

The data has been used to produce the three separate years where the target gas consumption was derived using a regression analysis  $Y = 0.5479C + 58,875$  (Where C is the production value in the month and the 58,875 the base load - refer to the figure below). The target gas consumption can be plotted alongside actual gas consumption in a simple monthly plot as opposed to the X/Y chart used for regression.

A	B	C	D
			$+0.5479C + 58875$
	<b>Gas consumed (kWh)</b>	<b>Production (m)</b>	<b>Target Gas (kg)</b>
<b>Jan y1</b>	205,508	303,324	225,066
<b>Feb y1</b>	236,076	292,705	219,248
<b>Mar y1</b>	225,793	349,221	250,213
<b>Apr y1</b>	153,837	172,780	153,541
<b>May y1</b>	168,192	263,875	203,452
<b>Jun y1</b>	202,310	239,004	189,825
<b>July y1</b>	111,818	123,365	126,467
<b>Aug y1</b>	249,594	309,962	228,703
<b>Sep y1</b>	243,548	252,177	197,043
<b>Oct y1</b>	265,188	317,583	232,879
<b>Nov y1</b>	269,711	382,054	268,202
<b>Dec y1</b>	191,291	309,366	228,377

The target gas consumption is the best fit performance. It is evident that sometimes the actual performance is better than target, and sometimes it is worse than target. That is not surprising since the red target line is derived from the best fit line for the data (refer to figures in the preceding report sections). The blue line is the actual gas consumed for monthly production values.

For clarity, the same data is plotted as an XY chart (so data points plotted in numerical order) in the illustration below.

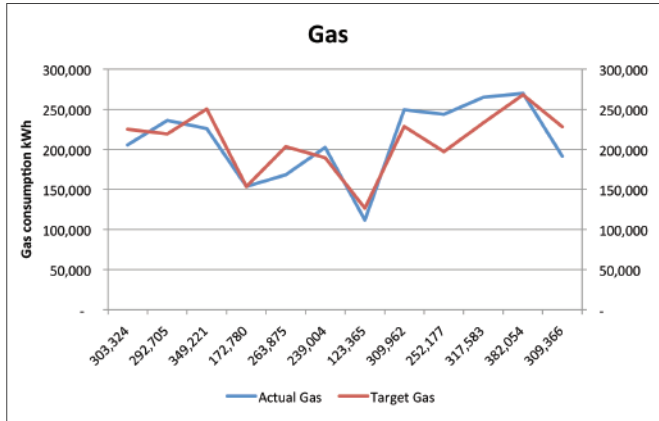

This can be checked by cumulatively summing the variation between the target gas consumption (best fit consumption and the actual gas consumption). Where in the first year we have derived the target gas from the best fit of the actual gas, the cumulative sum of variance is zero. In this case small rounding errors have left a residual of 150 (refer to the table below).

Ongoing performance can then be compared to the target consumption using the CUSUM technique. If improvements in performance are achieved and maintained, then the performance will be consistently better than target and the consecutive deviation will produce a cumulative deviation that increases in size. Below, all three years used in the example are tabled with a variance from target and cumulative variance or cumulative sum of error from target.


Because the target data is the best fit for the actual data - it is logical to assume (in fact it is statistically derived) that the actual gas consumed in the year will match the target gas despite monthly variances. Indeed the sum of all variances would be zero (otherwise the actual consumption would not match the target value).

**Example Production Figures**

A	B	C	D	F	G
			+0.5479C+58875	D - B	
	<b>Gas consumed (kWh)</b>	<b>Production (m)</b>	<b>Target Gas (kg)</b>	<b>Variance</b>	<b>Cumulative Variance</b>
<b>Jan y1</b>	205,508	303,324	225,066	19,557.85	19,557.85
<b>Feb y1</b>	236,076	292,705	219,248	- 16,828.32	2,729.53
<b>Mar y1</b>	225,793	349,221	250,213	24,420.59	27,150.12
<b>Apr y1</b>	153,837	172,780	153,541	- 295.86	26,854.26
<b>May y1</b>	168,192	263,875	203,452	35,260.31	62,114.57
<b>Jun y1</b>	202,310	239,004	189,825	- 12,484.83	49,629.73
<b>July y1</b>	111,818	123,365	126,467	14,648.66	64,278.40
<b>Aug y1</b>	249,594	309,962	228,703	- 20,890.62	43,387.78
<b>Sep y1</b>	243,548	252,177	197,043	- 46,504.76	- 3,116.98
<b>Oct y1</b>	265,188	317,583	232,879	- 32,309.63	- 35,426.61
<b>Nov y1</b>	269,711	382,054	268,202	- 1,508.72	- 36,935.33
<b>Dec y1</b>	191,291	309,366	228,377	37,086.05	150.71

A	B	C	D	F	G
			+0.5479C+58875	D - B	
	<b>Gas consumed (kWh)</b>	<b>Production (m)</b>	<b>Target Gas (kg)</b>	<b>Variance</b>	<b>Cumulative Variance</b>
Jan y1	205,508	303,324	225,066	19,558	19,558
Feb y1	236,076	292,705	219,248	- 16,828	2,730
Mar y1	225,793	349,221	250,213	24,421	27,150
Apr y1	153,837	172,780	153,541	- 296	26,854
May y1	168,192	263,875	203,452	35,260	62,115
Jun y1	202,310	239,004	189,825	- 12,485	49,630
July y1	111,818	123,365	126,467	14,649	64,278
Aug y1	249,594	309,962	228,703	- 20,891	43,388
Sep y1	243,548	252,177	197,043	- 46,505	- 3,117
Oct y1	265,188	317,583	232,879	- 32,310	- 35,427
Nov y1	269,711	382,054	268,202	- 1,509	- 36,935
Dec y1	191,291	309,366	228,377	37,086	151
Jan y2	198,448	327,590	238,362	39,914	40,065
Feb y2	185,661	289,778	217,644	31,983	72,047
Jan y2	240,280	377,159	265,520	25,241	97,288
Apr y2	132,701	184,875	160,168	27,467	124,755
May y2	172,285	240,126	190,440	18,155	142,910
Jun y2	169,032	236,614	188,516	19,484	162,394
July y2	109,301	119,664	124,439	15,138	177,531
Aug y2	205,648	334,759	242,289	36,642	214,173
Sep y2	182,339	239,568	190,134	7,795	221,968
Oct y2	211,435	285,825	215,478	4,043	226,011
Nov y2	243,506	385,875	270,296	26,789	252,800
Dec y2	211,335	315,553	231,767	20,431	273,232
Jan y3	171903.3	234,069	187,121	15,218	288,450
Feb y3	195605.1	221,441	180,202	- 15,403	273,047
Jan y3	179654.5	242,707	191,854	12,200	285,247
Apr y3	162019.6	155,077	143,841	- 18,178	267,069
May y3	167342.4	201,418	169,232	1,889	268,958
Jun y3	166112.7	187,927	161,840	- 4,273	264,685
July y3	128840.3	125,202	127,473	- 1,367	263,318
Aug y3	204298.1	240,138	190,447	- 13,851	249,467
Sep y3	160623.6	210,836	174,392	13,768	263,235
Oct y3	211441	249,180	195,401	- 16,040	247,195
Nov y3	229618.8	292,341	219,048	- 10,570	236,625
Dec y3	202879.6	237,512	189,008	- 13,872	222,753

Now since the variance has been defined as the difference between the target and the actual consumption, it follows that if the plant performance is consistently improved, there will be a constant positive variance. With a consistent positive variance from the time of improvement, the cumulative error will grow consistently compounding the error month on month. Likewise if the performance is on target, the net error will be zero (please see the explanation in the preceding paragraphs). If the CUSUM is plotted against time, the following is recorded.

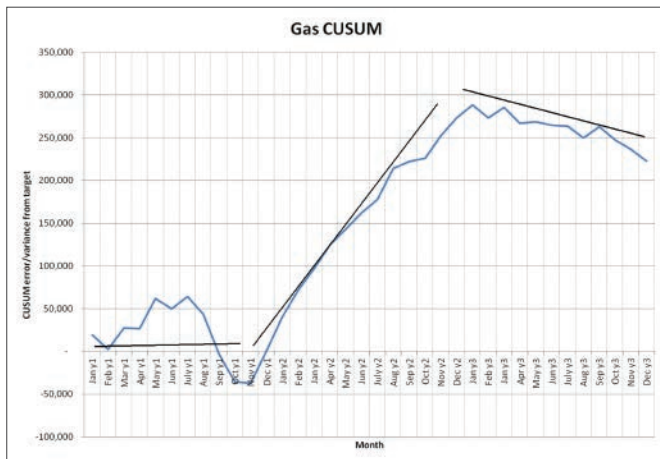

In the plot of cumulative error above the net position of year one is a flat line - as would be expected since the standard data set derives the best fit target for the comparison. In year two however the cumulative error grows consistently and the slope of the line is relatively constant suggesting a step improvement in efficiency that is maintained until the end of year two.

At the end of year two the slope of the line flattens and reverses suggesting that the efficiency is marginally worse than target.

The CUSUM is a reliable way of determining the underlying performance trend when that may not immediately be discerned from plots of raw data and target data (refer to below).

The CUSUM is not generally a means of identifying the allied cost which is more directly dealt with in tabular form. The CUSUM is an aid to determining quickly and accurately the nature and time of change.

**11.1 CUSUM convention**

The slope of the line in any CUSUM chart is dictated by the convention you have selected to determine variance.

If, for example, the variance is determined as the target, less the actual performance, then a good performance will result in a positive value and consistent maintenance of performance as a constant positive gradient.

If, for example, the variance is determined as the actual, less the target performance, then a good performance will result in a negative value and consistent improvement in performance as a constant negative gradient.

The convention is not important and relevance depends on the nature of the parameters being measured and how you wish to perceive savings benefit.

The key indicator is slope:

1	Flat line or no net change	On target maintaining target performance
2	Constant gradient	Maintaining an efficiency change (depends on convention i.e. an improvement was made and maintained)
3	Increasing or decreasing gradient	Performance is increasing or decreasing with time.

**11.2 Caution with CUSUM**

Using the convention in the example a positive gradient is good news and indeed reflects a saving. The reversal suggests poorer performance in year three. However it is necessary to use the regression techniques to understand the levels of control. For it is evident that the data grouping in year three exhibits more evidence of good control and the CUSUM technique whilst useful in evaluating trend quickly and the time of change or events cannot be used to determine the statistically significant improvements in control.

# 12.0 Feedback and reporting

In most cases the benefit of simply comparing energy consumption with a calendar period is inadequate. Generally a production adjusted comparison must be made. The techniques explained and exemplified in this guide allow you to do that.

Reporting and acting on the reports (which requires the engagement of the production staff) is the vital element of MM&T. MM&T is as much about understanding production and quality control as it is about managing energy.

People understand data in different ways, however generally graphical information is more readily and quickly understood. For each cost centre eventually selected there must be a simple report that shows and explains:

- What is the target performance for the cost centre?
- How does current performance compare with the target?
- Is the performance-getting better or worse?
- What is the extent of under or over achievement?
- What is the projected cost implication of the performance?
- Trend information.

A report for each cost centre might typically therefore contain a comparison for each measured SEC with a regression based target. It might provide an assessment of the cost of being above or below target and what is the best performance thus far.

The report would generally also provide a cumulative Year to Date (YTD) total of above and below target.

The regression chart might show the performance month on month plotted against the historical target. The fictitious charts used in the preceding illustrations, suggests regular “better than target” performance. However, that can be confirmed easily using both the control chart and the CUSUM chart to examine the degree of performance variation from an historical mean. Target limits set as described in this report and the cumulative performance improvement (or impairment) may also be used.

The fictitious CUSUM chart indicates the maintenance (steady positive gradient) of a 3% improvement illustrating the cumulative energy saving (remember this is convention specific).

All of the above may be completely automated in a customised spreadsheet or bespoke MM&T software. It is relatively easy to write an Excel import macro and use the automatic data fill capabilities of Excel to produce largely automated reporting and auto ranging graphics (e.g. regardless of the table fill the graph will automatically expand and recalculate the revised targets if desired).

However as explained, the same functions can be achieved without the effort using bespoke software.



# 13.0 How do you assess building energy performance?

13.1	Degree days . . . . .	42
13.2	Where do I get degree day figures from? . . . . .	42
13.3	Degree Days work in practice? . . . . .	45
13.4	Using the CUSUM analysis to verify trends . . . . .	46

### 13.1

#### Degree days

Building energy performance (heating or cooling) is directly related to the ambient conditions and heat lost or gained by the building space. Heat loss occurs as heat is conducted through the fabric of the building (the walls, the roof, the floor and the windows etc) and by ventilation (natural or mechanical) as air infiltrates or is extracted from the building.

In Northern Ireland most buildings will require some form of heating during the colder winter months and sometimes cooling during the warmer summer months. The heating demand is a function of the ambient temperature, the thermal properties of the building fabric and air infiltration (where heated air inside the building is replaced with cold ambient air as a result of natural ventilation or even the operation of mechanical ventilation systems).

The relationship of heat demand and ambient conditions can often be usefully examined using what are termed degree days. A degree day is simply a measure of the extent and duration of the variance from a selected external ambient temperature condition (base condition). In the UK it is generally accepted that heating will be required when the external ambient temperature falls below 15.5°C. So if ambient temperature were to fall below 15.5°C, it is anticipated that the heating system in a building will operate to maintain an acceptable internal temperature, during the programmed occupancy periods. Heating degree days are a measure of how much (in degrees), and for how long (in days), outside air temperature was lower than the selected base temperature. If the temperature were 14.5°C for a whole day then 1 degree day would have been accumulated, 2 degrees for a whole day would represent 2 degree days - and so on. In practice degree days calculated using the base of 15.5 are typically used but other base temperatures or time periods may be relevant for process applications. Cooling degree days are a measure of how much (in degrees), and for how long (in days), outside air temperature was higher than a specific base temperature. Cooling degree days may be correlated with the energy used for cooling a building e.g. the

power used for air conditioning. Just as for heating the demand and projected consumption for cooling can usually be calculated.

In the context of building energy consumption, monthly degree days (degree days accumulated in any calendar month) are normally sufficient to provide some relevant analysis of the heating control projected demand profile, total projected consumption and cost.

### 13.2

#### Where do I get degree day figures from?

Degree days can be calculated easily if external temperature is measured at your site. Alternatively degree days might be down loaded from <http://www.degreedays.net/>

For example, the following weather stations are available in Northern Ireland.

Station ID	Location
03915	Portglenone
03923	Glenanne
03916	Ballypatrick Forest
EGAC	Belfast / Harbour
I90580328	Cloughfern, Newtownabbey
03911	Lough Sea, N
EGAE	Londonderry Eglinton
IBELFAST4	Belfast, School of Geography
IBELFAST5	Hollywood Road, Belfast
IDOWNHIL3	Drumhill, Hillsborough
IDOWNCOM2	Comber
ICOUNTYD12	Corporation North, Newtownards
INORTHER5	Larne
ICODOWNB2	Quay Marinas Limited - Bangor Marina
ICODOWNN2	Conlig, Newtownards
ICODOWNB3	Bexley, Bangor
IDOWNBAN2	Ballyholme, Bangor
IDRAPERS2	Ballinascreen, Draperstown

These provide a fairly comprehensive degree day map of Northern Ireland and certainly sufficient for the purposes of estimating energy performance.

The concepts of target setting are discussed in the preceding report sections. Just as for the process related examples, building energy consumption can be similarly analysed. However, in the case of a building the energy consumption is correlated with degree days.


In the example below for a building in Belfast the heating consumption is tabled against the monthly degree days. The degree days are downloaded from <http://www.degree-days.net/> and the consumption is determined from the gas meter or the monthly gas invoices.

Month	Monthly Degree days	Heating Consumption (kWh)
Jun-13	80	9,062
Jul-13	25	4,312
Aug-13	34	5,682
Sep-13	87	10,594
Oct-13	132	15,425
Nov-13	290	35,535
Dec-13	282	34,196
Jan-14	327	37,252
Feb-14	289	32,090
Mar-14	277	31,548
Apr-14	176	21,072
May-14	133	14,340

The relationship (if any) with ambient conditions may now be determined from the correlation of degree days with heating consumption.

Just as per the process based analyses in the preceding report sections, the correlation indicates that there is a straight line relationship but that there is a fixed base load.

In the context of buildings energy analysis the “fixed” component of the energy consumption is usually reflective of domestic hot water demands, fixed losses and so on that are not generally influenced as significantly by ambient conditions. This methodology is an approximation.

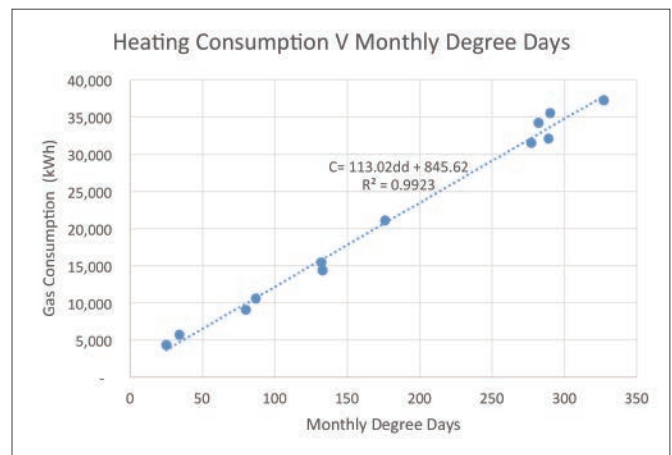

In this example MS Excel functionality has been used to determine the relationship as  $C = 113.02dd + 845.62$  - where C is the consumption and dd is the degree days. The target consumption for any month can then be determined.

The gradient of the graph will be a function of the thermal properties of the building. The intercept will relate to losses independent of external weather conditions and typically associated with heating system standing losses, boiler cycling losses and often in some significant part, the domestic hot water load.

The analysis is an approximation only and should of course be used with appropriate caution and good knowledge of the installed services and the operation of these.

A	B	C	D	E	
			$B \times 113.02 + 845.13$	C-D	
Month	Monthly Degree Days	Actual Heating Consumption (kWh)	Target Consumption (Standard or Base)	Variance	CUSUM
Jun-13	80	9,062	9887.22	- 825	- 825
Jul-13	25	4,312	3671.12	641	- 184
Aug-13	34	5,682	4688.3	994	811
Sep-13	87	10,594	10678.36	- 85	726
Oct-13	132	15,425	15764.26	- 339	387
Nov-13	290	35,535	33621.42	1,913	2,300
Dec-13	282	34,196	32717.26	1,479	3,779
Jan-14	327	37,252	37803.16	- 551	3,228
Feb-14	289	32,090	33508.4	- 1,418	1,810
Mar-14	277	31,548	32152.16	- 604	1,206
Apr-14	176	21,072	20737.14	335	1,541
May-14	133	14,340	15877.28	- 1,538	3
	<b>2132</b>	<b>251,109</b>	<b>251,106</b>		

In this case and because the data set has been used to derive the initial target figure, the cumulative sum of the error from target is logically zero. However the same mechanism can be used to predict:


- monthly energy consumption and cost
- annual energy and cost
- reductions or improvements in the heating efficiency

**13.3****Degree days work in practice?**


The process may be developed as additional data is collected. The target consumption is calculated from the actual degree day data every month using the formula derived for the standard or base consumption set. The data is tabled and calculated as illustrated below:

<b>A</b>	<b>B</b>	<b>C</b>	<b>D</b>	<b>E</b>	
			$B*113.02+845.13$	C-D	
<b>Month</b>	<b>Monthly Degree Days</b>	<b>Actual Heating Consumption (kWh)</b>	<b>Target Consumption (Standard or Base)</b>	<b>Variance</b>	<b>CUSUM</b>
Jun-13	80	9,062	9,887	- 825	- 825
Jul-13	25	4,312	3,671	641	- 184
Aug-13	34	5,682	4,688	994	811
Sep-13	87	10,594	10,678	- 85	726
Oct-13	132	15,425	15,764	- 339	387
Nov-13	290	35,535	33,621	1,913	2,300
Dec-13	282	34,196	32,717	1,479	3,779
Jan-14	327	37,252	37,803	- 551	3,228
Feb-14	289	32,090	33,508	- 1,418	1,810
Mar-14	277	31,548	32,152	- 604	1,206
Apr-14	176	21,072	20,737	335	1,541
May-14	133	14,340	15,877	- 1,538	3
Jun-14	78	9,456	9,643	- 187	- 184
Jul-14	24	3,802	3,575	227	43
Aug-14	35	5,168	4,765	403	446
Sep-14	79	10,715	9,823	892	1,338
Oct-14	128	15,749	15,361	388	1,726
Nov-14	309	36,230	35,785	445	2,172
Dec-14	254	29,971	29,562	409	2,581
Jan-15	346	40,775	39,947	828	3,409
Feb-15	270	32,743	31,353	1,390	4,799
Mar-15	267	33,206	30,994	2,212	7,011
Apr-15	181	21,587	21,354	233	7,244
May-15	132	15,929	15,727	202	7,446

On first inspection no obvious deviation is apparent. The actual consumption might be plotted against the target consumption using the relationship derived for the base or standard data (Jun 2012 – May 2013). Inspection would reveal some deviation but it would be hard to determine whether the heating performance was better or worse.

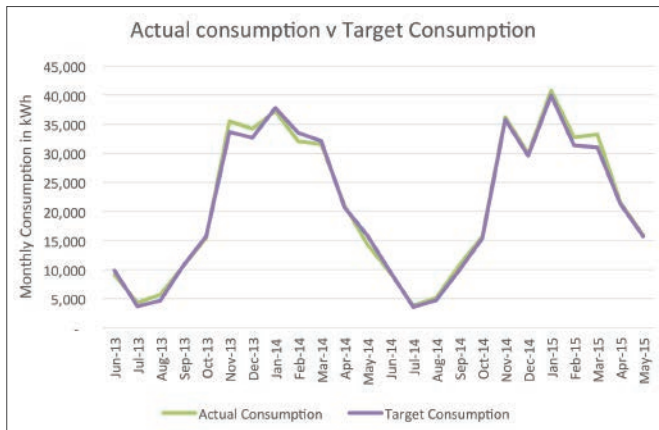


Plotting the respective performances on an XY chart shows that the consumption in 2014-2015 is generally higher than the 2012-2013 base line data and it might therefore be concluded that the energy performance was therefore worse (because the target is compensated for external ambient temperature).

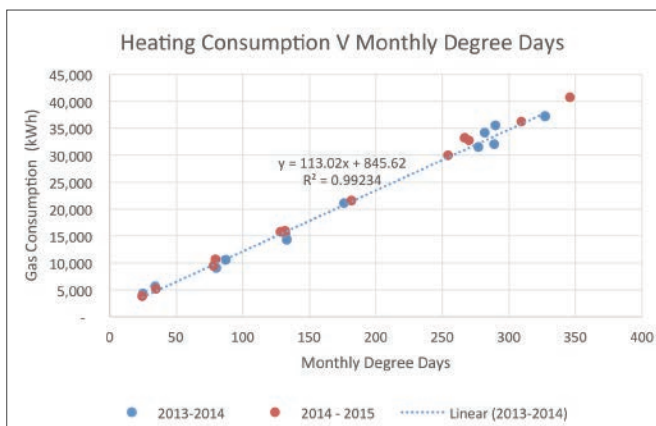

### 13.4 Using the CUSUM analysis to verify trends

The CUSUM technique is however the single best means of reliably interpreting trend and if the errors from the 2013-2014 target for 2014-2015 consumption data were assembled as per the preceding table and the CUSUM plotted, then the reduction in efficiency and increased energy consumption trend becomes apparent.

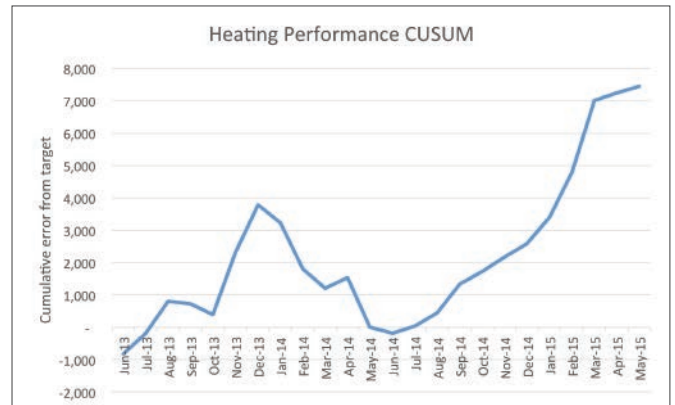

The performance over 2013 varied seasonally and was used to derive the target (the base line data) – The relatively constant increase month on month in error from target (Manifest as a relatively constant gradient chart line) indicates that there was a step change in performance from June 2014 and that performance loss was maintained throughout 2014 until Feb 2015 when the performance was recovered slightly (reflected in the reduced gradient of the charted cumulative error).

Although a straight comparison of actual versus target data is often difficult to interpret a regression plot should be easier to interpret. However, the CUSUM technique is useful in identifying trends when there are small but consistent changes in performance.

# 14.0 Energy Performance in Buildings - Key Legislative Changes

14.1	Energy performance certificates and energy benchmarking . . . . .	48
14.2	Building Logbooks . . . . .	48
14.3	What is in a Building Logbook? . . . . .	48
14.4	Energy Savings Opportunity Scheme (ESOS) . . . . .	49

In 2009 buildings accounted for about 43% of all the UK's carbon emissions. The Government has introduced legislation to reduce carbon emissions from buildings and make sure that planning policies help to protect and improve the natural and built environment.

The Government has included policies in the National Planning Policy Framework to explain how developments should be planned to reduce carbon emissions and protect the environment.

To reduce carbon emissions from buildings, the Government:

- are requiring local planning authorities to make sure that new developments are energy efficient.
- will require all new homes to be zero carbon from 2016 and are considering extending this to include all other buildings from 2019.
- have introduced the green deal to enable people to pay for home improvements over time using savings on their regular energy bills.
- have improved Energy Performance Certificates to make them more informative and user-friendly. The 2010 Directive (2010/31/EU) has been implemented in Northern Ireland through the Energy Performance of Buildings (Certificates and Inspections) (Amendment) Regulations (Northern Ireland) 2013. These regulations amend the 2008 Regulations to implement Articles 4, 11, 12, 13, 16 and 27 of the 2010 Directive. The Energy Performance of Buildings (Certificates and Inspections) (Amendment) Regulations (Northern Ireland) 2014, which came into operation on 25 February 2014, implement Articles 2(9), 11(2)(a), 11(2)(b), 11(3) and 13(2) of the Directive.
- have introduced the Code for Sustainable Homes which provides a single national standard for the design and construction of sustainable new homes.

#### 14.1

##### **Energy performance certificates and energy benchmarking**

The Department for Communities and Local Government (DCLG) is responsible for making sure buildings in the UK meet the standards required by the EU's Energy Performance of Buildings Directive.

The Directive requires that:

- all properties (homes, commercial and public buildings) must have an Energy Performance Certificate (EPC) when sold, built or rented.

- larger public buildings over 500m<sup>2</sup> must display a Display Energy Certificate (DEC)
- all air-conditioning systems over 12kW must be regularly inspected by an Energy Assessor.

EPCs are produced by accredited energy assessors using standard methods and assumptions about energy usage. This means that the energy efficiency of one building can easily be compared with another building of the same type. This allows prospective buyers, tenants, owners, occupiers and purchasers to see information on the energy efficiency and carbon emissions from their building so they can consider energy efficiency and fuel costs as part of their investment.

An EPC includes a recommendation report that lists cost-effective and other measures to improve the building's energy rating.

#### 14.2

##### **Building logbooks**

Building Logbooks are legally required for new commercial buildings and for existing buildings where the building services provision is altered. The Government alleges that building logbooks will improve the information that facilities managers or building managers have in regard of building energy performance. The theory is that building managers will then be able to influence the energy performance of the building – In practice building managers may not be qualified, experienced or able to programme the services control systems. However, buildings logbooks will allow ongoing building energy performance, to be recorded.

The theory is that logbooks will improve the understanding, management and operation of buildings resulting in lower costs and reduced carbon dioxide (CO<sub>2</sub>) whilst contributing to improved comfort, and productivity.

#### 14.3

##### **What is in a Building Logbook?**

The logbook should provide access to information on the design, commissioning and energy consumption of the building. Again in theory, it is intended that a building manager will be able to manage controls and settings to improve energy efficiency.

The log book will also provide detailed information about metering strategies implemented in the building and the scope for monitoring and benchmarking energy consumption.



CIBSE TM31: Building Logbooks an Authors guide  
GPG348 'Building logbooks a users guide' available  
at [www.thecarbontrust.co.uk](http://www.thecarbontrust.co.uk)

#### **14.4**

##### **Energy Savings Opportunity Scheme (ESOS)**

ESOS (Energy Savings Opportunity Scheme) presents a new significant opportunity for large UK businesses.

The ESOS is a mandatory scheme for large organisations in the UK. It requires organisations to undertake a regular assessment to identify cost effective energy savings measures. This scheme was established by the Department of Energy and Climate Change (DECC) in response to the requirement for all Member States of the European Union to implement Article 8 of the Energy Efficiency Directive.

# 15.0 Other Useful Reading

**Monitoring and targeting (Carbon Trust Guide)**

[www.carbontrust.com/media/31683/ctg008\\_monitoring\\_and\\_targeting.pdf](http://www.carbontrust.com/media/31683/ctg008_monitoring_and_targeting.pdf)

Energy Efficiency in Buildings CIBSE Guide F

Statistical Process Control: Theory and Practice  
(Wetherhill and Brown) Textbook

If you require this leaflet in an alternative format (including Braille, audio disk, large print or in minority languages to meet the needs of those whose first language is not English) then please contact:

**Invest NI Equality Team**

**T : 028 9069 8273**

**Text Relay Number : 18001 028 9069 8273**

**E-mail : [equality@investni.com](mailto:equality@investni.com)**



Bedford Square  
Bedford Street  
Belfast BT2 7ES  
**T : 028 9069 8000**  
**F : 028 9043 6536**  
Text Relay Number: 18001 028 9069 8000

**[investni.com](http://investni.com)**